
Detail of Well Construction
for
Town of Williams
Williams, Iowa

Layne Western Company, Ames, Iowa — April 1965

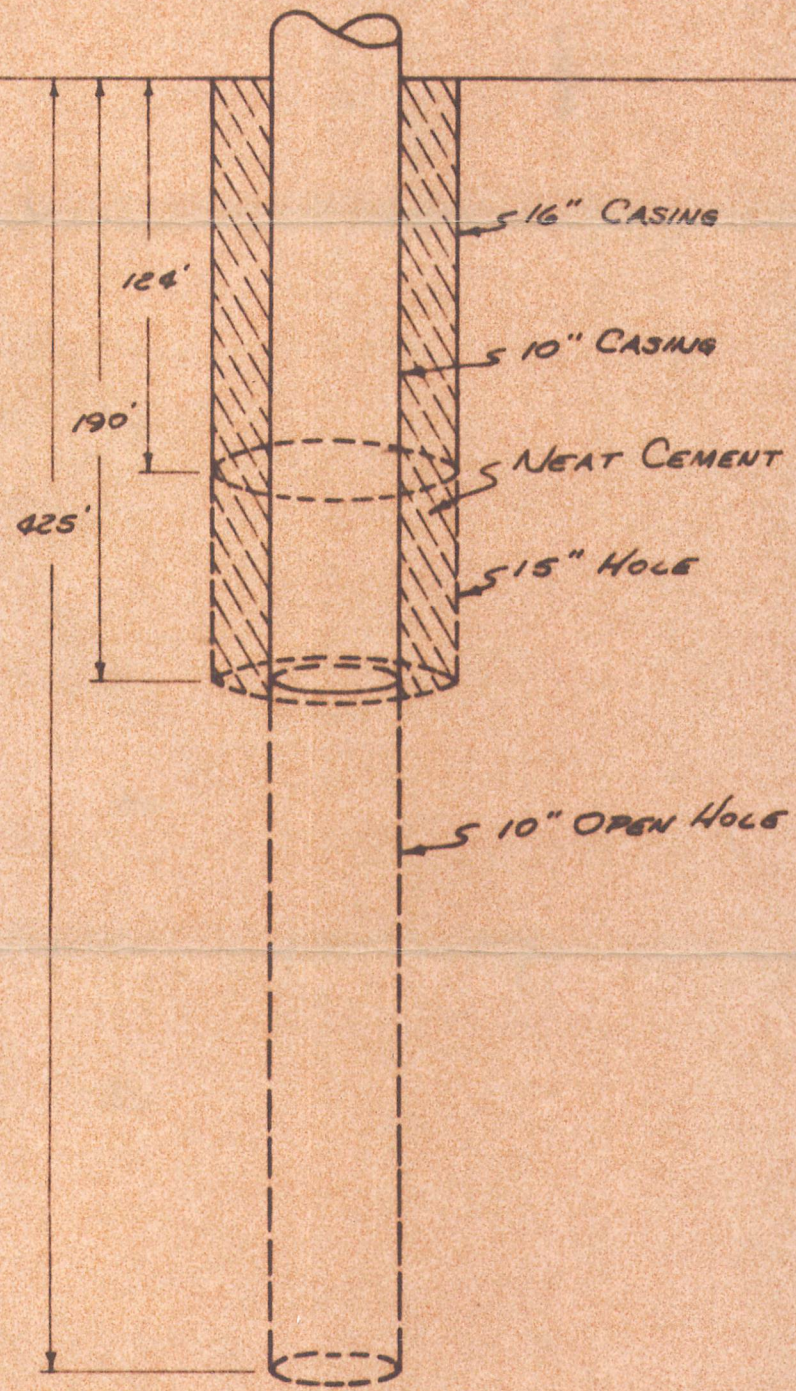

GEOLOGICAL SURVEY
JUN 28 1965

Static Level 94'	Capacity 156 GPM	Pumping Level 170'	Drawdown 76'