
Auxiliary Water Well
for
Town of Pisgah, Iowa
Nov. 1966

Index of Sheets

1. Schematic & Approvals
2. Soil Boring Data & Details of Aux. Well

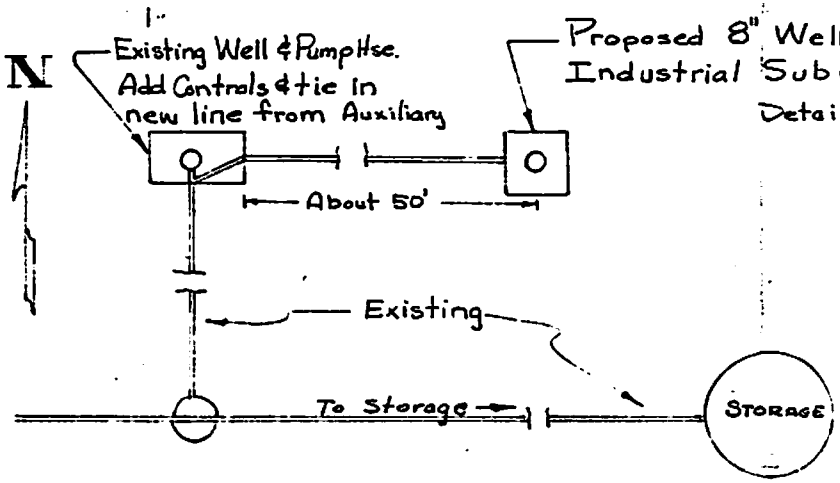

Schematic Layout
Pisgah Water Supply

PLANS AND SPECIFICATIONS
APPURTENANT TO
APPROVAL NOTICE NO. 67-46-W
Dated June 9 19 67
IOWA STATE DEPARTMENT OF HEALTH
Commissioner, M.D.
Director, Division of Engineering

APPROVED _____
DATE _____
MAYOR OF PISGAH, IOWA


I hereby certify that this plan, specification or report was prepared by me or under my direct personal supervision and that I am a duly registered professional engineer under the laws of the State of Iowa.

Signed Edward G. Bigelow Nov. 1, 19 66
EDWARD G. BIGELOW, P.E. Iowa Reg. No. 6126

Revised 5/16/67 E.G.B.
1. Casing Weight
2. Added chlorination note
3. Added venting & screen
4. Added serviceable check valve in pump.

DEPARTMENT OF HEALTH
STATE OF IOWA
APPROVED _____
DATE _____


Units

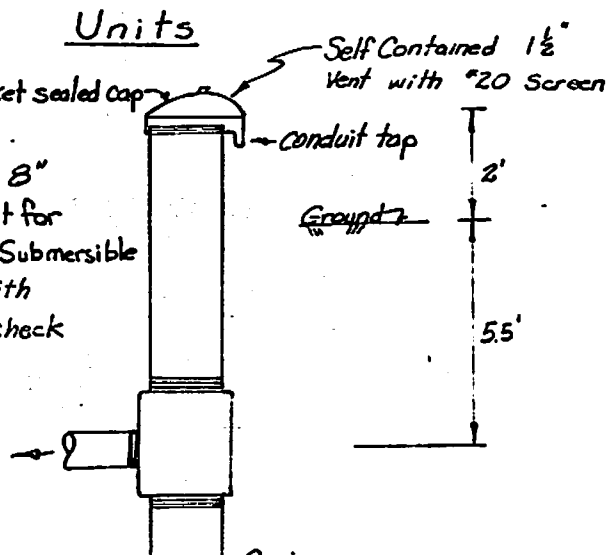

Monitor P.S. 8" Pit less unit for Industrial Submersible Pump with serviceable check valve.



JOHNSON 15' Stainless Steel Welded Well Screen

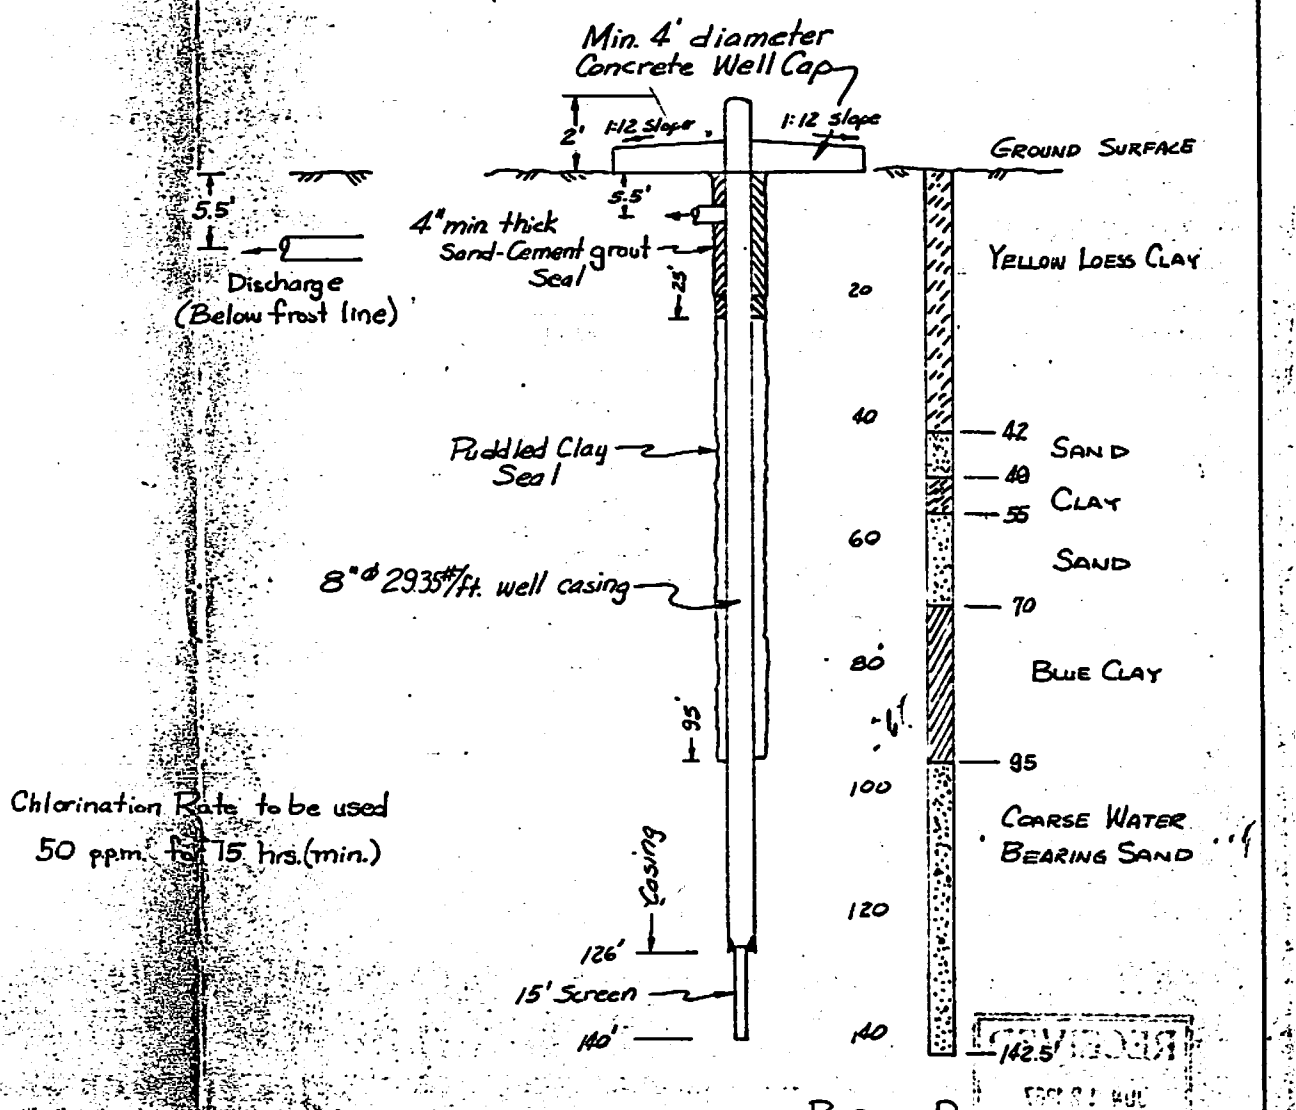

Chlorination Rate to be used
50 p.p.m. for 15 hrs.(min.)

I hereby certify that this plan, specification or report was prepared by me or under my direct personal supervision and that I am a duly registered Professional Engineer under the laws of the State of Iowa.

BORING DATA
Vert. Scale 1"=20'