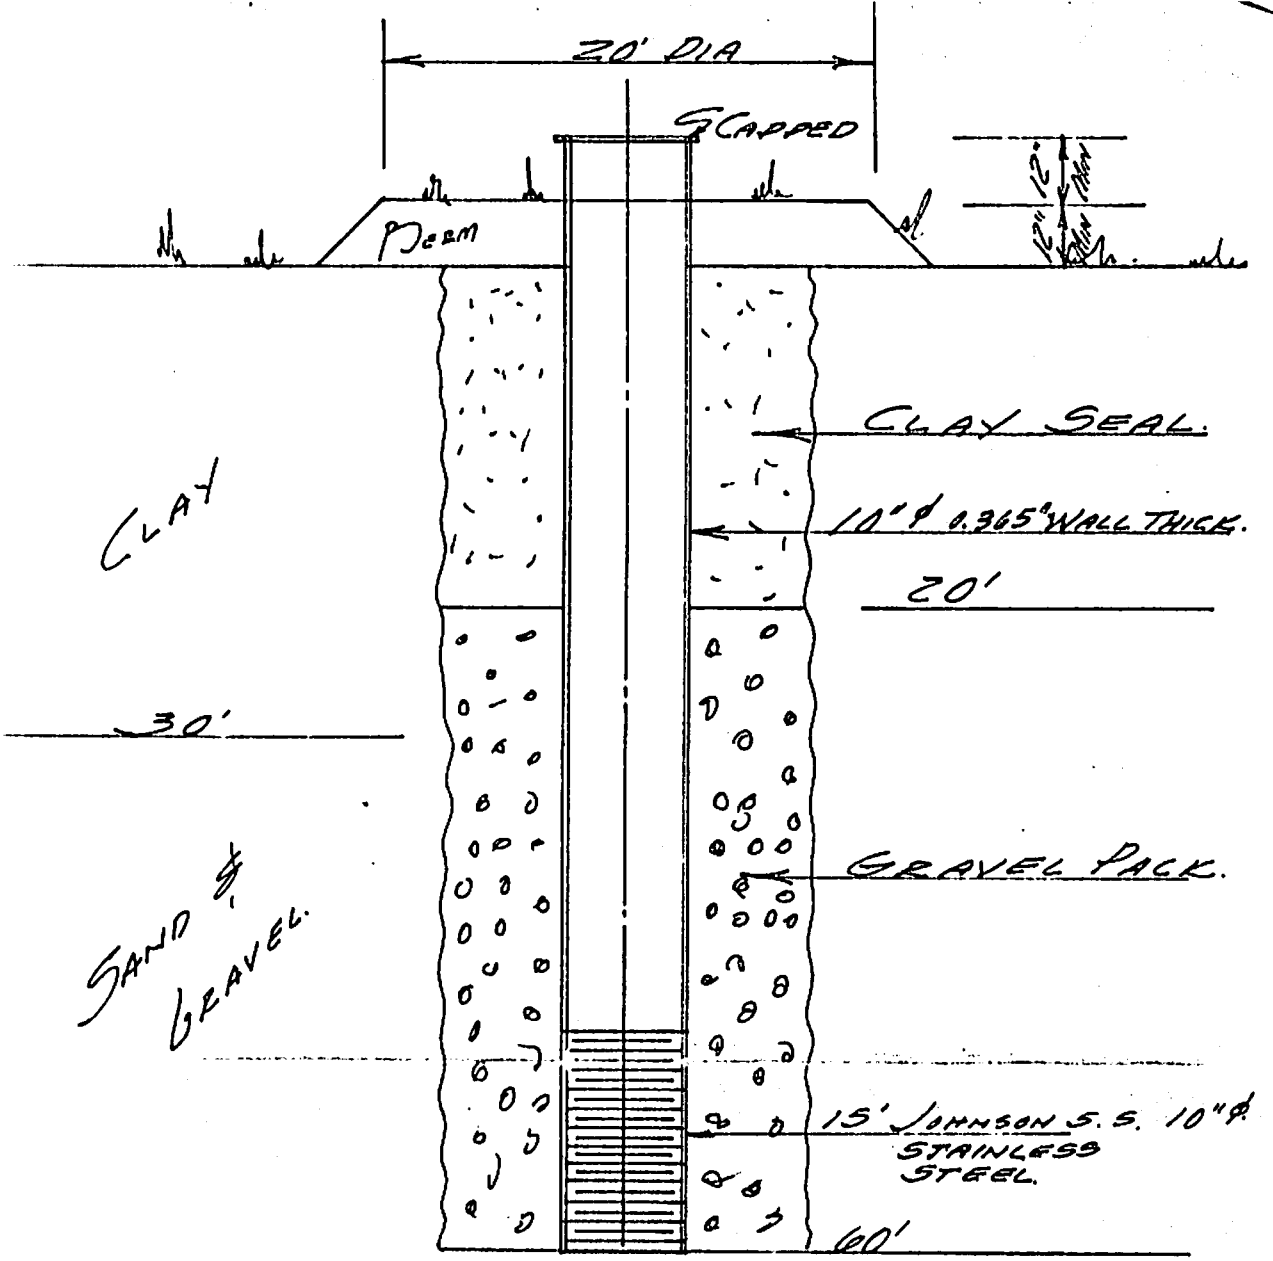



PROPOSED WELL FOR THE TOWN OF EXIRA, IOWA

This well shall be sterilized with a 50 p.p.m. chlorine solution for a minimum contact period of 24 hours; chlorine shall be added while placing the gravel pack; and the well shall be capped upon completion.

PLANS AND SPECIFICATIONS APPURTENANT TO
APPROVAL NOTICE NO. 69-23-W
Dated April 30, 1969
IOWA STATE DEPARTMENT OF HEALTH
Commissioner
Chief, Environmental Engineering

50