
Details of Well Construction
for
Gilmore City, Iowa
Well No. 1

Layne-Western Co. December, 1957

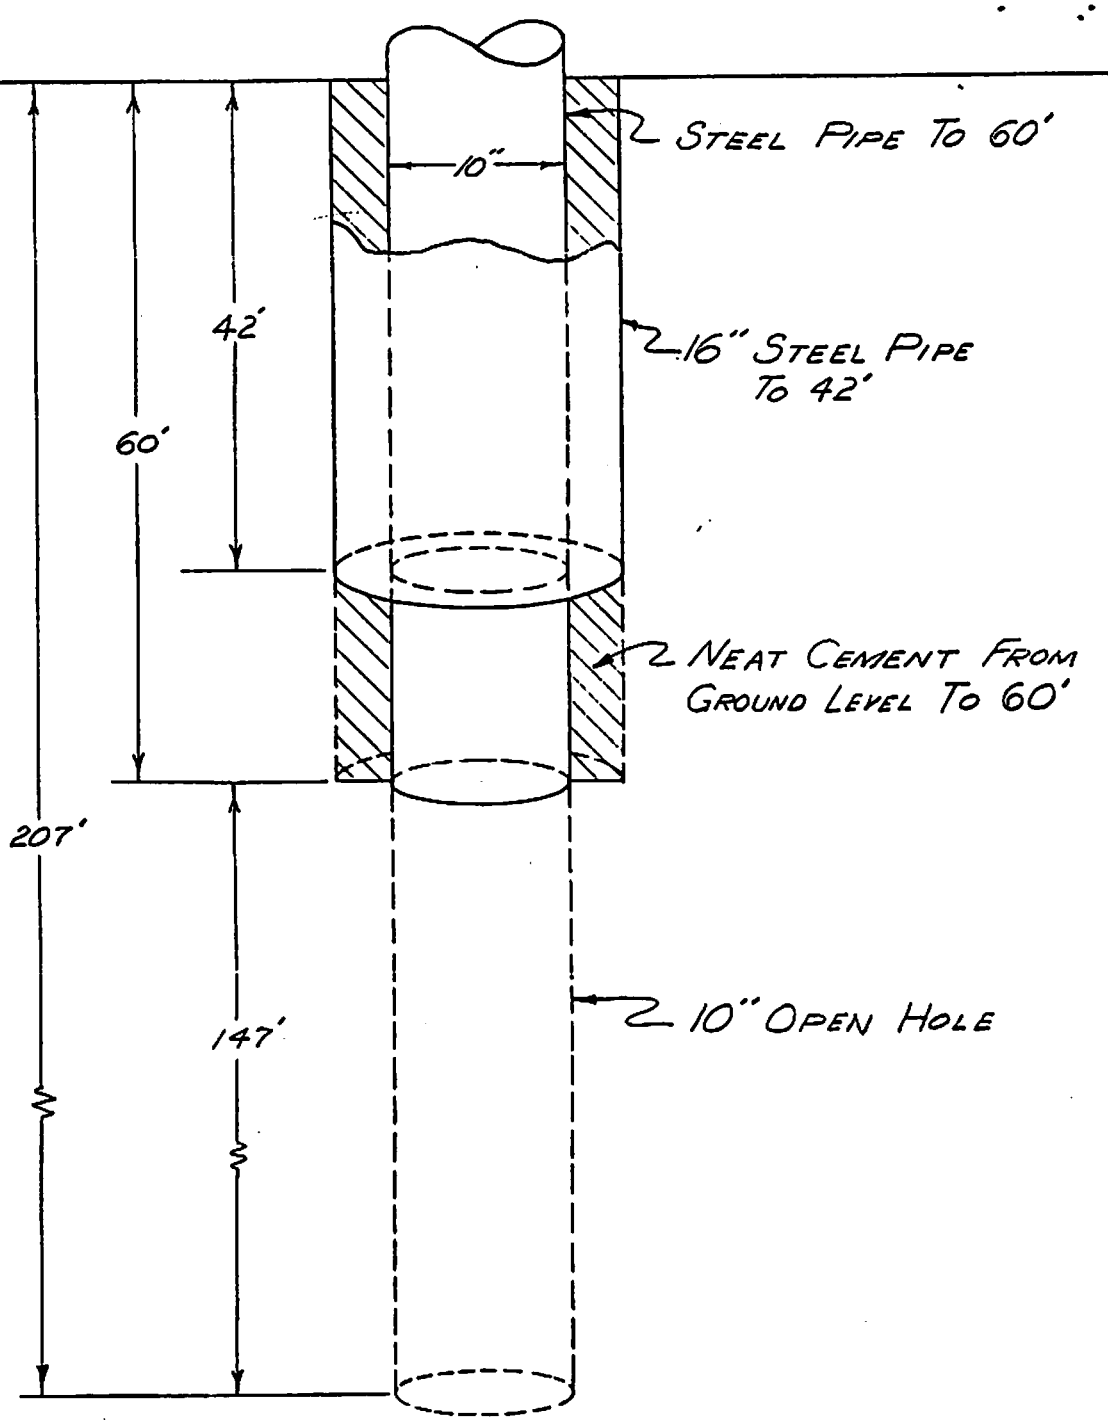

Pumping Test			
Static Water Level	72 ft.	Drawdown	6 ft.
Pumping Rate	425 G.P.M.	Pumping Level	78 ft.